



RETAIL EQUIPMENT LTD

Cabinet Type	Multi Deck Combined Half Glass over Well			
Model Designation	GDG			
File Reference	1258			
Document Issue	1	24-03-14	LRC	First Issue

cabinet **TECHNICAL DATA**

Cabinet Technical Data Sheet – GDG

Product Type	Frozen Food/Ice Cream
Product Temperature	-18°C / -23°C
Maximum Design Ambient	25°C 60%RH

Case Length [m]	3.75	2.50	1.87
------------------------	-------------	-------------	-------------

Refrigeration Data

Refrigeration Duty (per 24hrs) [kW] ISO3	2.63	1.75	1.31
Evaporating Temperature [°C] – L1	-35	-35	-35
Evaporating Temperature [°C] – L2	-32	-32	-32
Nett Environmental Cooling	0.66	0.44	0.33
R404A AKV Expansion Valve Size	No5	No4	No3
R404A T2 Orifice Size	No3	No2	No2
Evaporator Liquid Capacity @ 25% R404A [kg]	4.0	2.6	2.0
Refrigeration Pipe Tail – Liquid	3/8"	3/8"	3/8"
Refrigeration Pipe Tail – Suction	7/8"	7/8"	7/8"

Electrical Data (@ 230V 50Hz)

	Watts	Amps	Watts	Amps	Watts	Amps
Defrost Heaters	4000	17.39	2800	12.17	2000	8.69
Fans	147	0.64	98	0.43	75	0.32
Trim Heaters	841	3.66	540	2.35	456	1.98
Solenoid Valve / Controller	10	0.04	10	0.04	10	0.04
Lights	110	0.48	76	0.33	56	0.24
Maximum Load – Electric Defrost	5108	22.21	3524	15.32	2597	11.27

Electrical Data (@400V 3ph 50Hz)

	L1	L2	L3	L1	L1	L2	L1	L2	L3
Maximum Load – Electric Defrost	5	9	9	4	4.4	4.4	2.6	4.4	4.4

Miscellaneous Data

Refrigeration Connections	Underside of Cabinet LHS
Electrical Connection	Underside of Cabinet LHS


Set-Up Data**

	Frozen Food -18/-21°C	Ice Cream -21/-23°C
Cut in Temperature [°C]	-24	-27
Differential [K]	2	2
N° Defrosts (per 24hrs)	2	2
Maximum Defrost Time [mins]	45	45
Defrost Termination Temp (air off) [°C]	1	1
Drain Down Time [mins]	2	2
Fans in Defrost	On	On
Cabinet Temperature Ratio (%)	60	60
Superheat [K]	5	5
Trim Heater Control (%)	60	60
Expansion Valve Operation	Cycle	Cycle

NOTES!

** Set-up data is for guidance only. Final settings to be determined by commissioning contractor.


Section Drawing – GDG

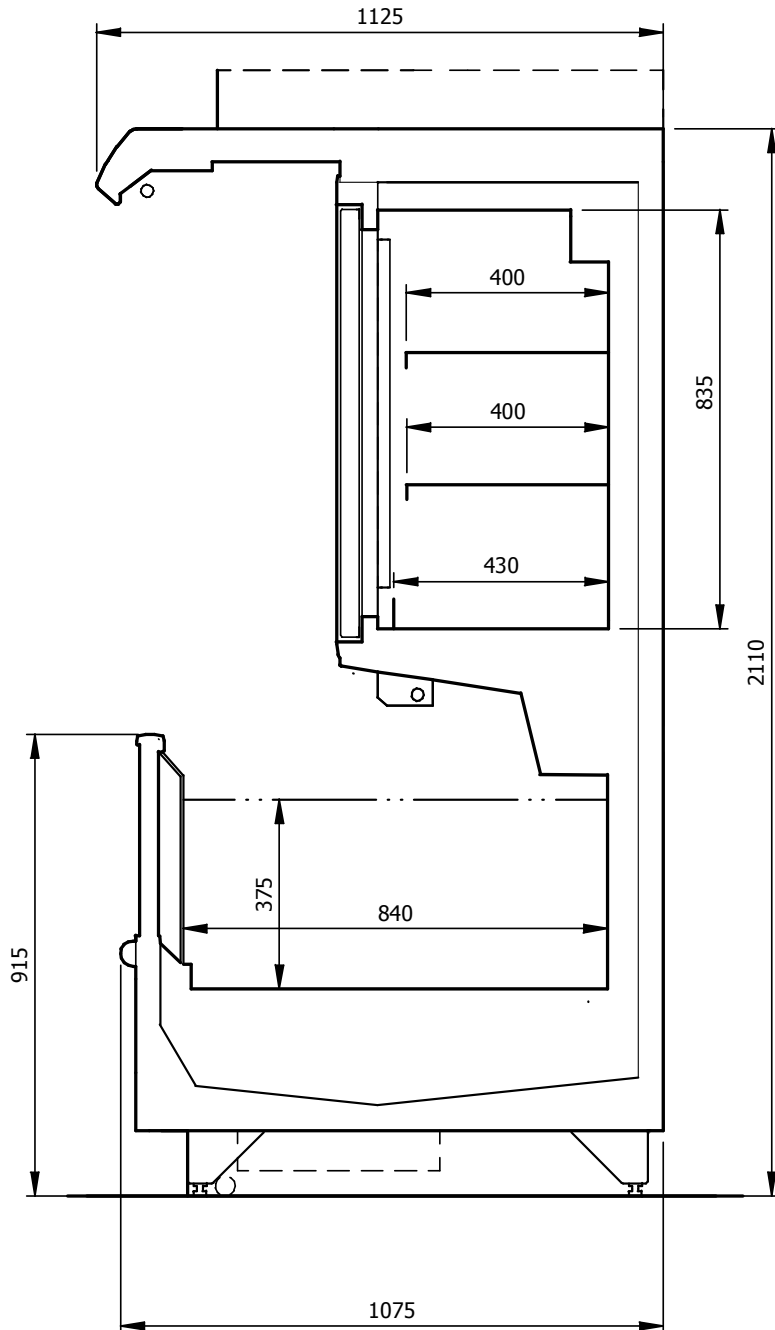

Ref:- DS1104-02

Plan Drawing – GDG

- KEY
- Feet Positions
 - Refrig. Outlets
 - ◐ Drain Outlets
 - ⊗ Elect. Outlets
 - ⊗ Mains Supply

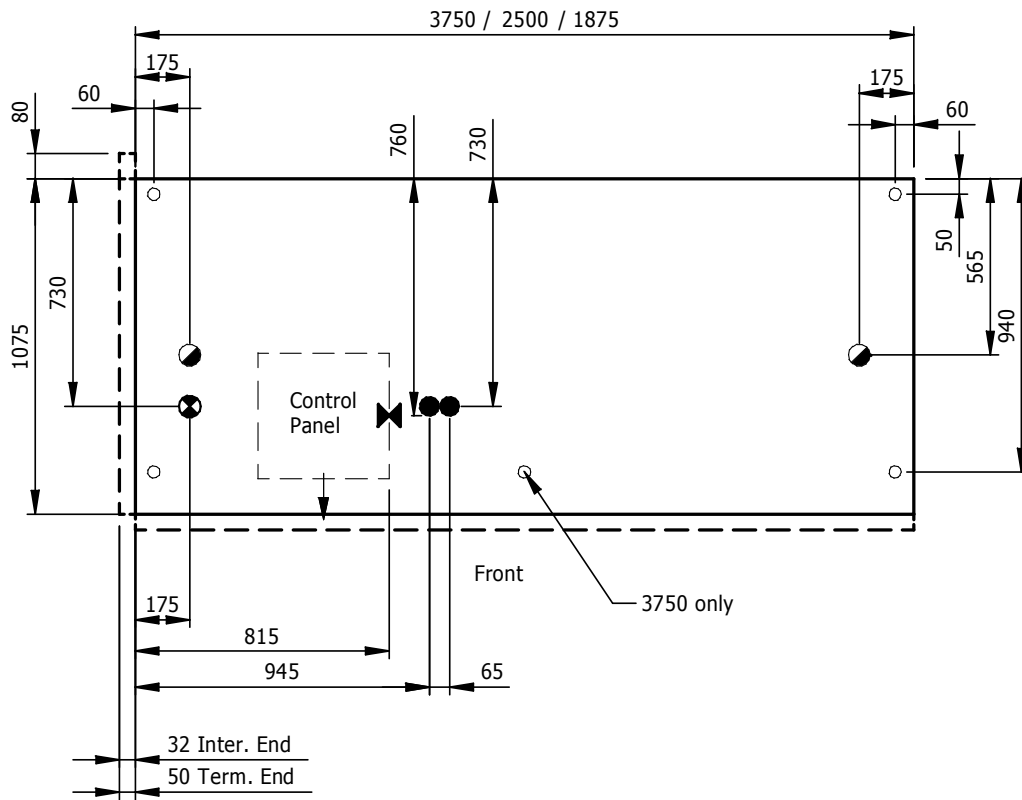

Plan of Base

Ref:- DP1104-1